

Aggregate - Evaluation

Product designation: SHW 803 Type 1 0 / 32 OC75 Gp UF9 C90/3

Producer: Isle of Grain Wharf

Source: Granite

Delivery / Sampling

Sampled/ tested

Sample No: SIGA/0113874

04/12/2023 11:04

Sampler: Nick Collingwood

Sampling point:

Loading point 2

Place of sampling: Site

Initiator

Isle of Grain Wharf

Weather

Project designation:


Comments

SAMPLE ANALYSIS

EN 933-1: Particle size distribution, Sieving method

Sieve size	Passing %	Specification limits	Complies?
63 mm	100	100 - 100	yes
31.5 mm	90	75 - 100	yes
16 mm	62	52 - 81	yes
8 mm	42	32 - 62	yes
4 mm	31	23 - 53	yes
2 mm	26	14 - 40	yes
1 mm	21	10 - 30	yes
0.063 mm	8.5	0.0 - 9.0	yes
Water content:	2.6	not specified	-
Uniformity coefficient	131.1	not specified	-
<i>Additional grading requirements:</i>			
passing 16.0mm - ret 8.0mm	20	7 to 30	yes
passing 8.0mm - ret 4.0mm	11	7 to 30	yes

Remark

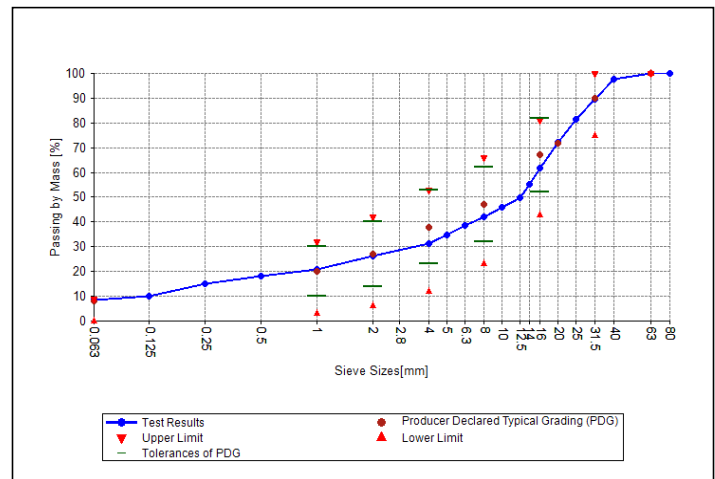

Kent, 09/01/2024



Timothy Cooke

Aggregates/Asphalt ATM



Timothy Cooke

Aggregates/Asphalt ATM